


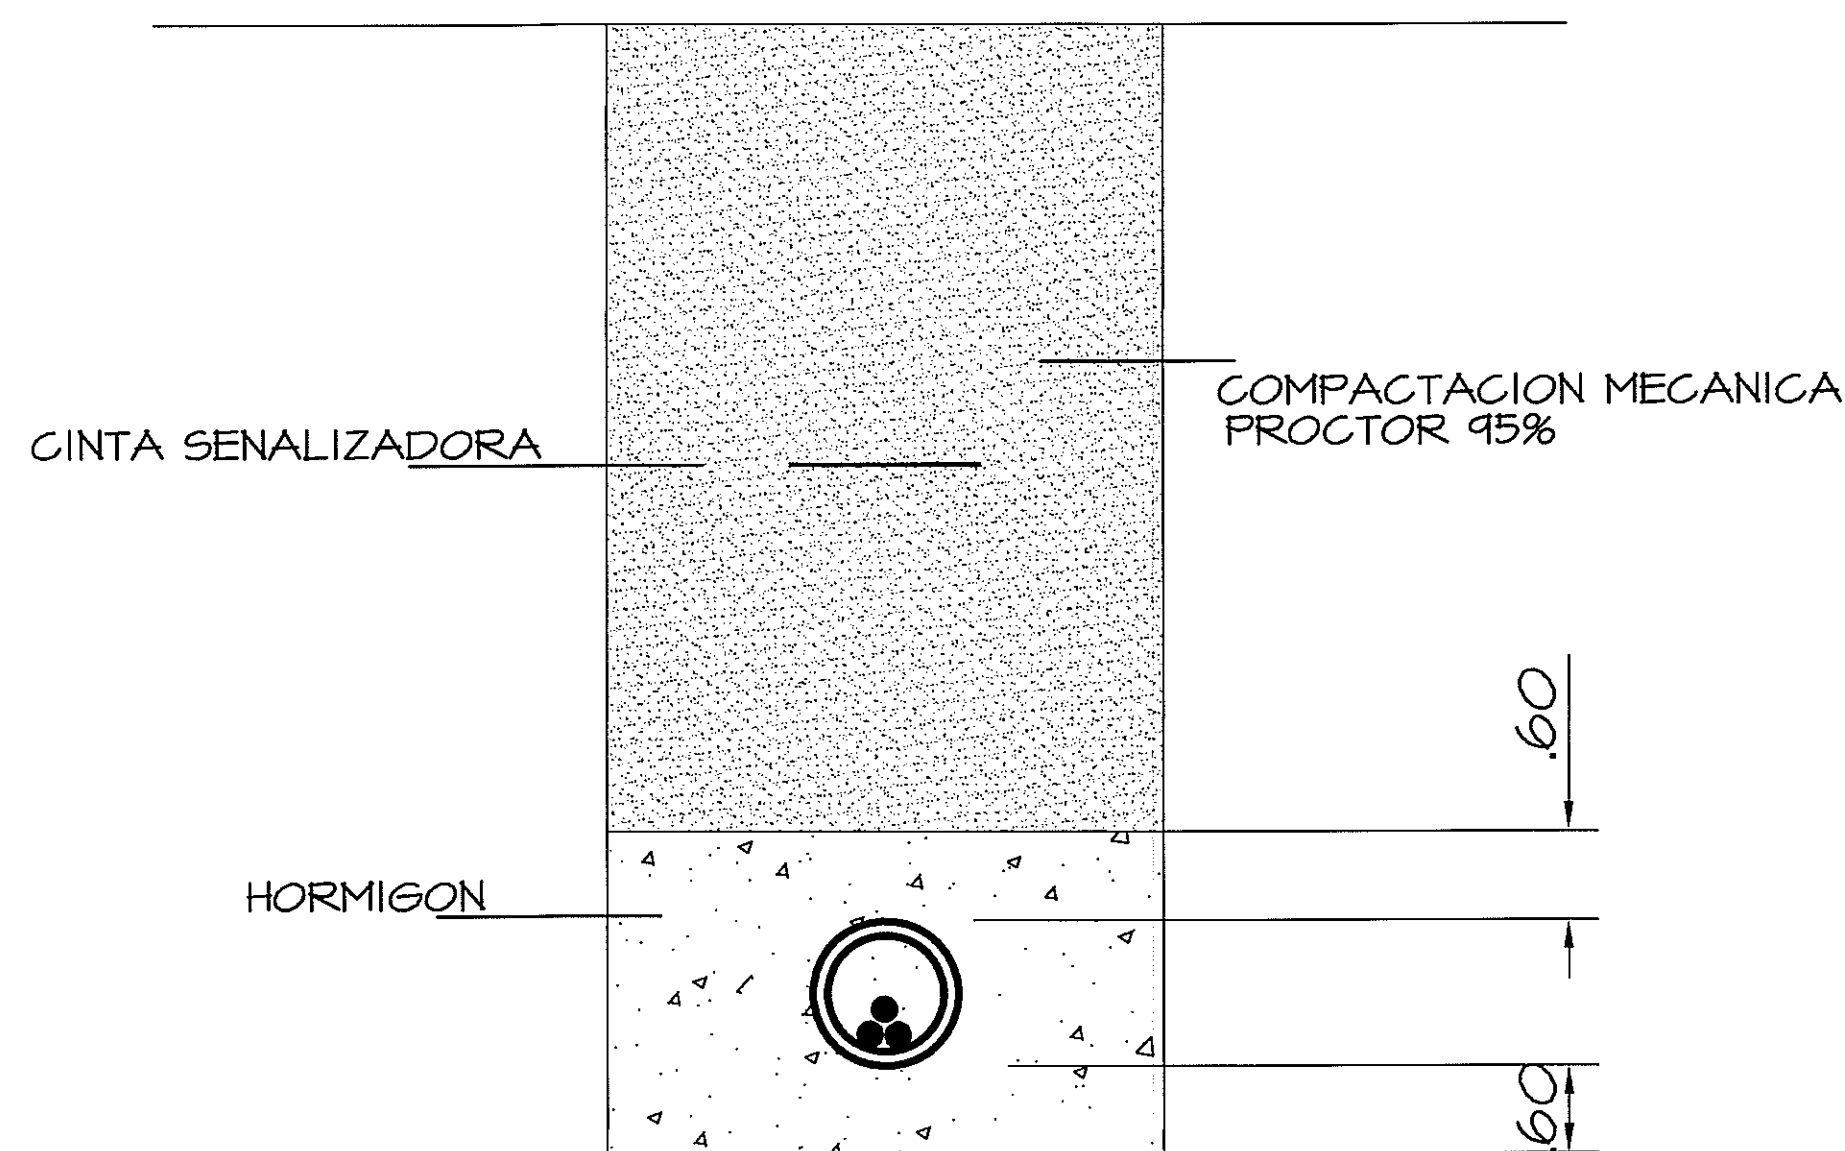

1 #8 AWG. DESNUDO

INTERRUPTOR INDUSTRIAL 100 AMP, 3 POLOS 208 V

VARILLA DE TIERRA 5/8" ϕ x 8'

3C#2 THHN
1C#2 THHN
1C#8 DESNUDO
2" ϕ PVC.

The diagram illustrates the wiring for a 3-phase industrial disconnect switch. The switch is a 100-amp, 3-pole, 208V unit. The top terminal is connected to a 1#8 AWG bare wire. The bottom terminal is connected to a 3C#2 THHN, 1C#2 THHN, 1C#8 bare, and 2-inch diameter PVC conduit assembly. A ground rod (5/8 inch diameter, 8 feet long) is also shown connected to the ground terminal.

Diagrama de conexión para un banco de capacitores trifásico de 6 kVAR. El diagrama muestra un sistema de tres fases (BK, BK, BK) con una tensión de 208 V y 3 polos. El cableado incluye un cable 3C#10 THHN que se conecta a un tablero de distribución "A" (8 CTOS 120/208V, 2 polos) y a un circuito de control. El banco de capacitores está conectado a través de un contactor de 25A.

Ver Bo
Lent
9/7/13
HWA 4 DE 8

POLICLINICA DR. MANUEL DE JESUS ROJAS